


U:\000661 - Rapho\aprsNeeds Area.apr View & Layout Newtown 11x17 6/12/07

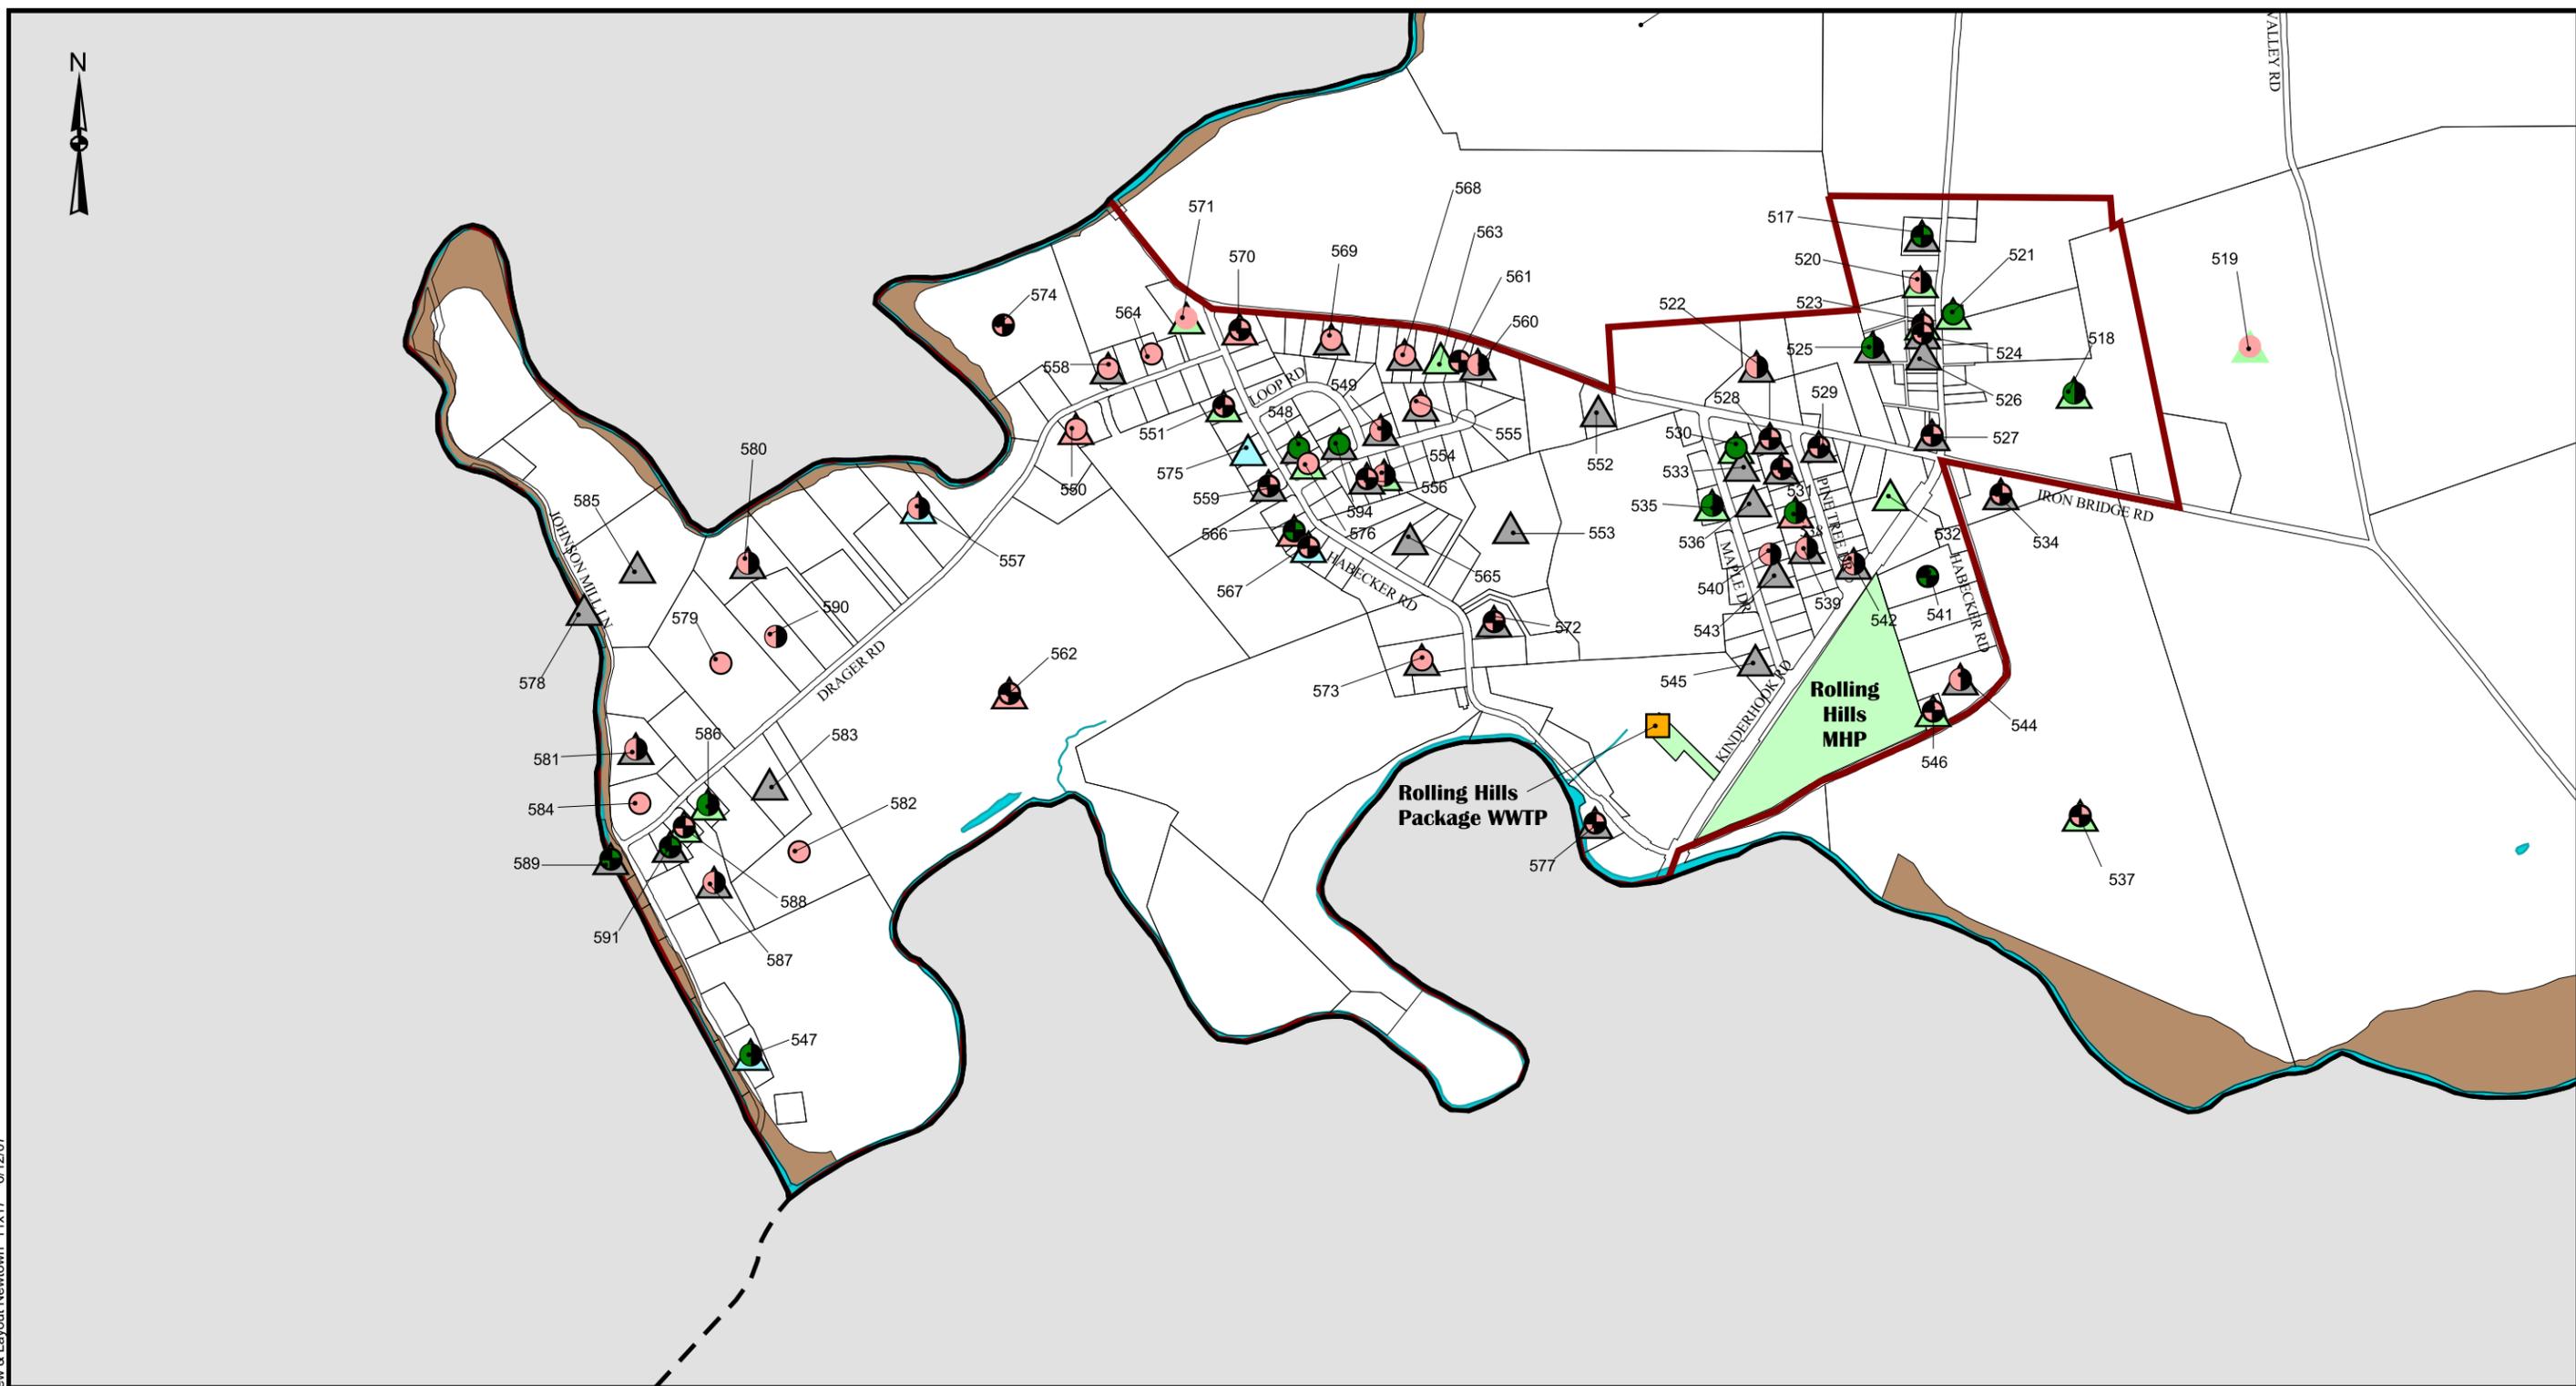

- Municipal Boundaries
- Wastewater Facilities
- OLDS Areas Evaluated
- Sewer Service Areas
- Floodplains
- Wetlands
- Parcels
- Bodies of Water

- WELL RESULTS**
- Wells with no Bacteria Detected and Nitrate Levels < 5 mg/l
 - Wells with no Bacteria Detected and Nitrate Levels 5-10 mg/l
 - Potential Malfunction Wells with no Bacteria Detected and Nitrate Levels > 10 mg/l
 - Wells with Bacteria Detected and Nitrate Levels < 5 mg/l
 - Wells with Bacteria Detected and Nitrate Levels 5-10 mg/l
 - Potential Malfunction Wells with Bacteria Detected and Nitrate Levels > 10 mg/l

- SANITARY SURVEY RESULTS**
- Confirmed Malfunction
 - Suspected Malfunction
 - Potential Malfunction
 - No Detected Malfunction


Rapho Township
 Lancaster County, PA

Figure III-2
ACT 537 SEWERAGE
FACILITIES PLAN
Newtown Area
 Prepared by 

800 0 800 Feet
